State of Utah
Bacteriological Flow Chart

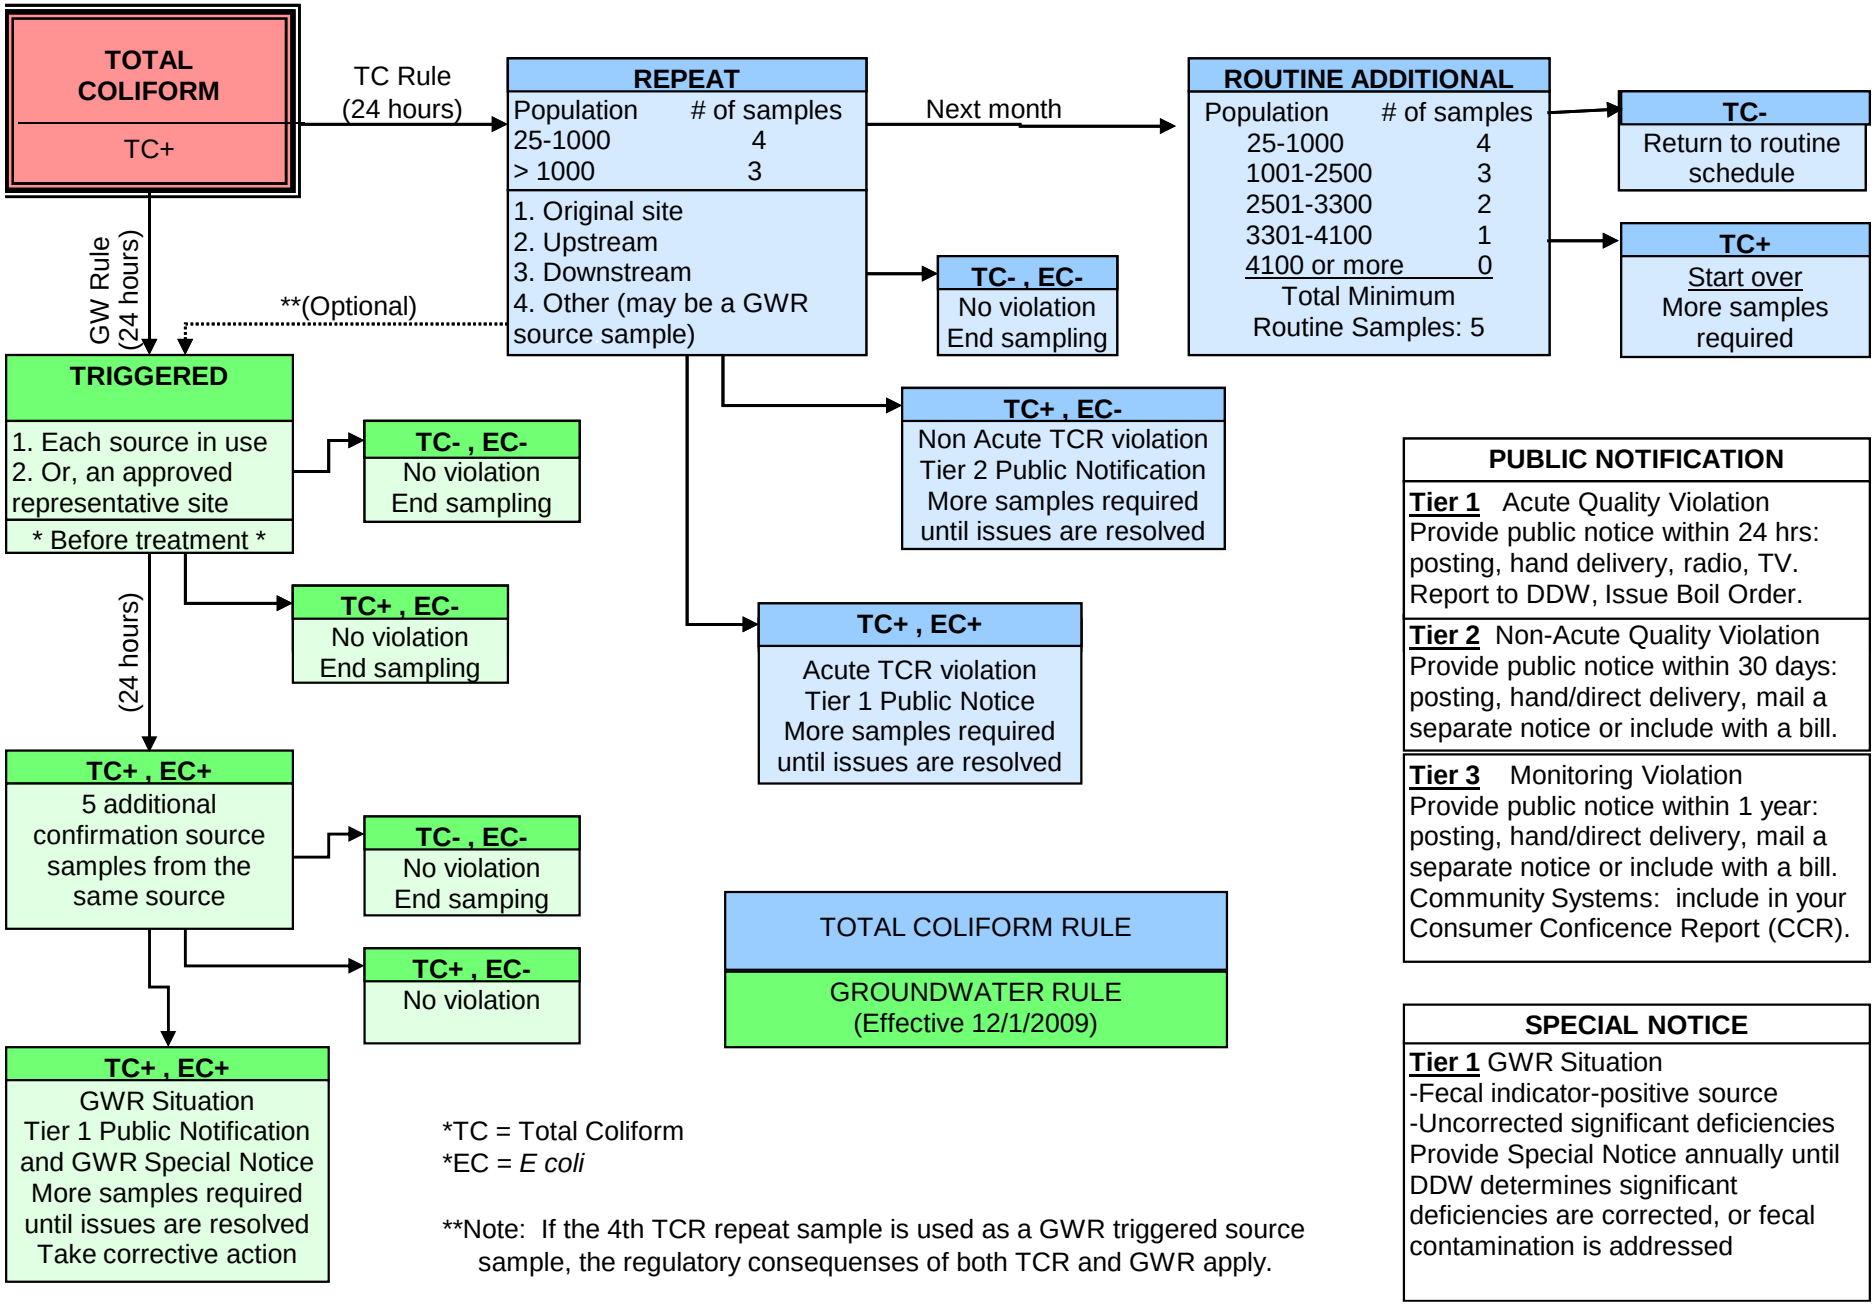

PUBLIC NOTIFICATION

Tier 1 Acute Quality Violation
Provide public notice within 24 hrs: posting, hand delivery, radio, TV. Report to DDW, Issue Boil Order.

Tier 2 Non-Acute Quality Violation
Provide public notice within 30 days: posting, hand/direct delivery, mail a separate notice or include with a bill.

Tier 3 Monitoring Violation
Provide public notice within 1 year: posting, hand/direct delivery, mail a separate notice or include with a bill. Community Systems: include in your Consumer Conficence Report (CCR).

SPECIAL NOTICE

Tier 1 GWR Situation
-Fecal indicator-positive source
-Uncorrected significant deficiencies
Provide Special Notice annually until DDW determines significant deficiencies are corrected, or fecal contamination is addressed

*TC = Total Coliform
*EC = *E coli*

**Note: If the 4th TCR repeat sample is used as a GWR triggered source sample, the regulatory consequenses of both TCR and GWR apply.